



**CITY OF CAMBRIDGE**  
MASSACHUSETTS  
Water Department  
250 Fresh Pond Parkway  
Cambridge, MA 02138  
617 349 4770  
fax 617 349 6616



July 1, 2010

## **JUNE, 2010 WATER SUPPLY SUMMARY REPORT**

### **Highlights**

- Reporting period 6/1/10 - 7/1/10
- Hobbs, Stony and Fresh Pond are currently at 87%, 88%, 93%\* capacity respectively. (\*Based on total reservoir storage, not gross usable capacity)
- Measured June precipitation (3.47") is consistent than Massachusetts NE region June normals (3.49").
- Fresh Pond level sensor malfunction, equipment on order, manual readings conducted daily

### **Storage**

Figure 1: Hobbs Brook Reservoir Storage, June 2010

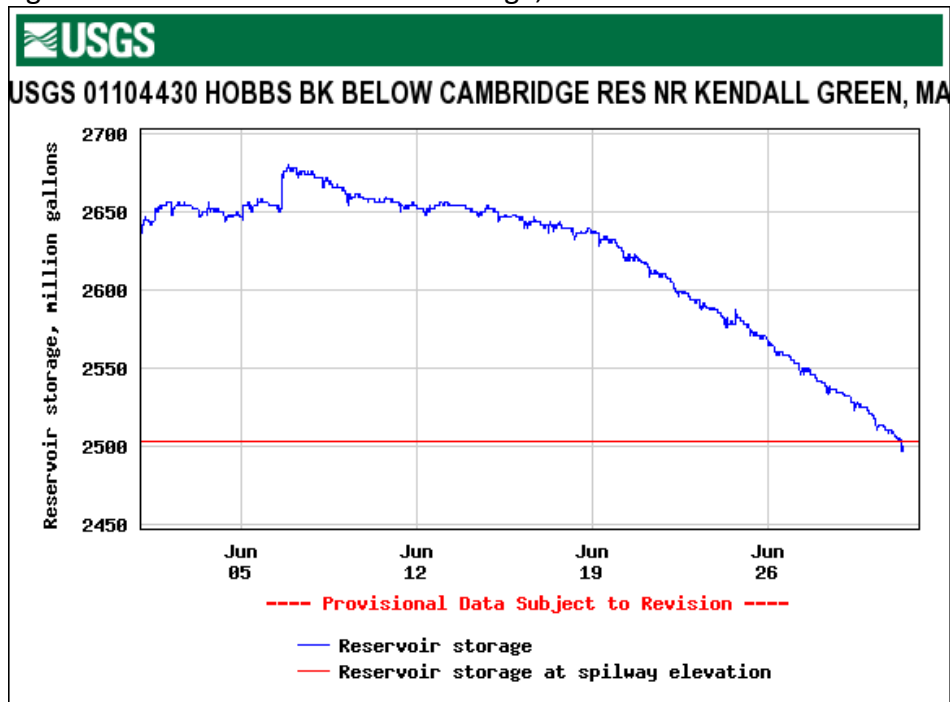


Figure 2. Stony Brook Reservoir Storage, June 2010



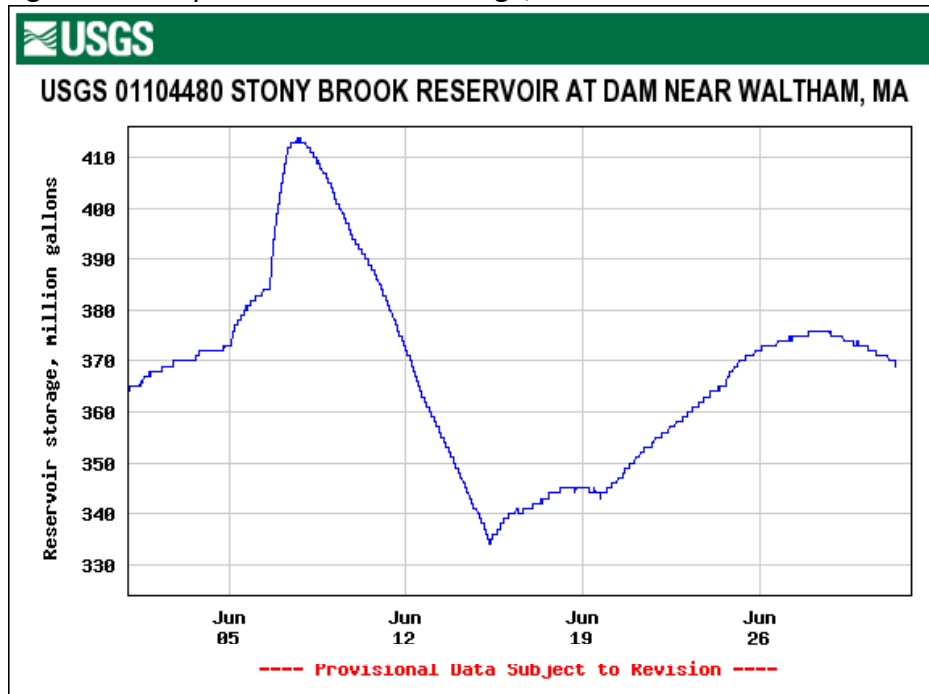


Figure 3. Fresh Pond Reservoir Storage, June 2010

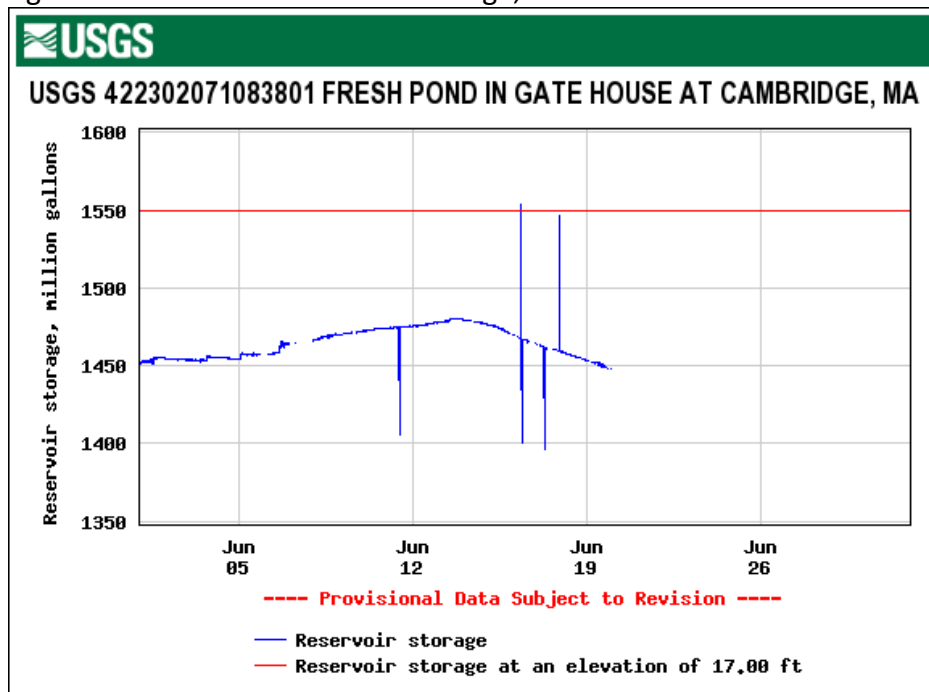

## Precipitation

Figure 4. Rainfall at Hobbs Brook Reservoir, June 2010

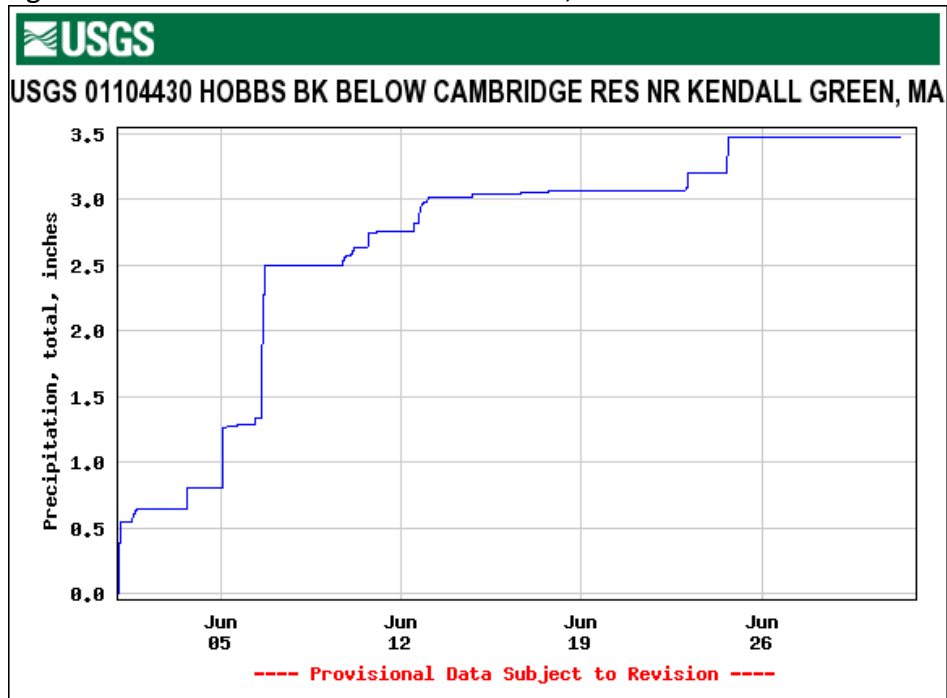

David Kaplan, Watershed Protection Supervisor

[dkaplan@cambridgema.gov](mailto:dkaplan@cambridgema.gov)

617-349-4799

Real-time data available on the web at

[http://waterdata.usgs.gov/ma/nwis/current?type=cambrid&group\\_key=NONE&search\\_site\\_no\\_station\\_nm=&format=html\\_table](http://waterdata.usgs.gov/ma/nwis/current?type=cambrid&group_key=NONE&search_site_no_station_nm=&format=html_table)